Atlas Concrete Products
1-800-774-1112

P-017
Electrial Transformer pad



Section A-A

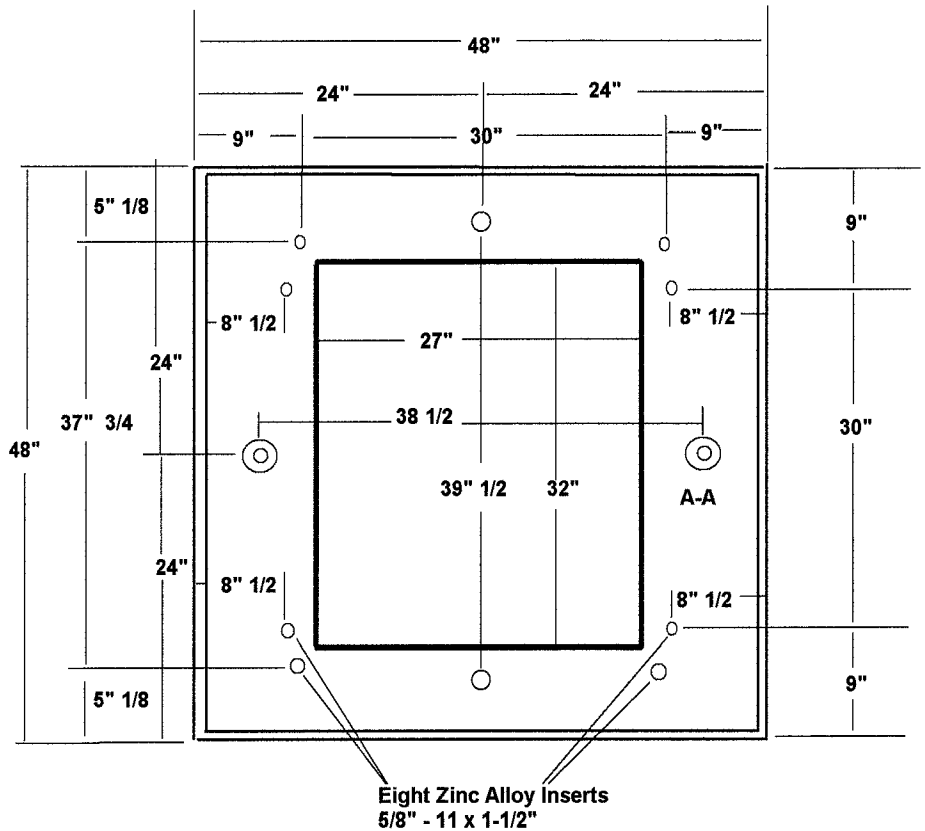

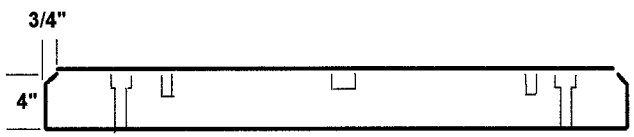

Notes

Concrete Compressive Strength 5,000 PSI @ 28 days

Meets State and Local Specifications

Meets All Provisions of Northeast United Illuminating

Manufacturer's identification and month/year when manufactured shell be legibly marked in/on concrete in the top within 4 inches of the opening.

Concrete and concrete design shall be in accordance with ACI 318-1986

Two 3/4 inch coil loop inserts (Dayton F63) with an insert locator plug (Dayton T21) for lifting the pad with a swivel plate.